


NOTES:

- 1) HOT MIX ASPHALT (HMA) CL. 1/2 IN. PG 64-22, WITH MINIMUM COMPACTED DEPTH OF 4" OR EXISTING PAVEMENT DEPTH PLUS 1", WHICHEVER IS GREATER UP TO A MAXIMUM DEPTH OF 6". PLACE IN LIFTS WITH A MAXIMUM COMPACTED DEPTH OF 2" PER WSDOT STANDARD SPECIFICATION 5-04, AND MACHINE ROLL FLUSH WITH EXISTING PAVEMENT.
- 2) 5/8" MINUS CRUSHED SURFACING TOP COURSE WITH 2" MINIMUM DEPTH, COMPACTED TO 95% MAXIMUM DENSITY. IF THE EXISTING PAVEMENT DEPTH IS GREATER THAN 8", THE MINIMUM COMPACTED DEPTH OF CRUSHED SURFACING TOP COURSE SHALL BE EQUAL TO THE DEPTH OF THE EXISTING PAVEMENT MINUS 6".
- 3) EXCAVATION AND BACKFILL SHALL BE IN ACCORDANCE WITH SECTION 2-09 OF THE WSDOT STANDARD SPECIFICATIONS. IMPORTED MATERIAL USED FOR BACKFILL SHALL BE CONSISTENT AGGREGATE FOR CRUSHED SURFACING AS DEFINED IN SECTION 9-03.09(3) OF THE WSDOT STANDARD SPECIFICATIONS. BACKFILL MATERIAL SHALL BE PLACED IN 1' MAXIMUM LOSE LIFTS AND COMPACTED TO 95% MAXIMUM DENSITY.
- 4) PIPE INSTALLATIONS SHALL BE IN ACCORDANCE WITH SECTION 7-03 AND SECTION 7-08 OF THE WSDOT STANDARD SPECIFICATIONS.
- 5) MATERIAL USED FOR PIPE BEDDING MATERIAL SHALL BE CONSISTENT GRAVEL BACKFILL FOR PIPE ZONE BEDDING AS DEFINED IN SECTION 9-03.12(3) OF THE WSDOT STANDARD SPECIFICATIONS. BEDDING MATERIAL SHALL BE PLACED IN 1' MAXIMUM LOOSE LIFTS AND COMPACTED TO 95% MAXIMUM DENSITY. DEPTH OF MATERIAL SURROUNDING PIPE SHALL BE ADEQUATE TO SUPPORT THE PIPE AND TRENCH.
- 6) NEAT, UNIFORM AND VERTICAL CUT (TYPICAL BOTH SIDES). CLEAN AND HEAT EDGES AND TACK WITH EMULSIFIED ASPHALT. SEAL JOINT WITH HOT ASPHALT CEMENT (AR 4000 TYPICAL).
- 7) MINIMUM RESTORATION LIMITS UNLESS OTHERWISE DETERMINED BY THE ENGINEER. IF ANY PORTION OF A LONGITUDINAL PAVEMENT CUT AFFECTS A WHEEL TRACK AS DETERMINED BY THE ENGINEER, THE ENTIRE LANE SHALL BE REMOVED AND REPLACED. WHEREVER AN EXISTING PATCH OR CRACK IS IN CLOSE PROXIMITY TO THE NEW CUT, THE ENGINEER MAY REQUIRE REMOVAL OF THE EXISTING PATCH OR CRACK AND ANY INTERVENING PAVEMENT. DEPTH OF REPLACEMENT ASPHALT SHALL BE IN ACCORDANCE WITH NOTE 1.
- 8) ALL PERMANENT FINAL PATCHES SHALL BE RECTANGULAR OR CIRCULAR IN SHAPE AND CONSTRUCTED TO BE PARALLEL AND PERPENDICULAR TO THE ROAD CENTERLINE.
- 9) CONTROLLED DENSITY FILL (CDF) MAY BE REQUIRED ON PRINCIPAL ARTERIAL ROADWAYS AND SHALL BE PLACED IN ACCORDANCE WITH WSDOT STANDARD SPECIFICATIONS 2-09.3(1)E.

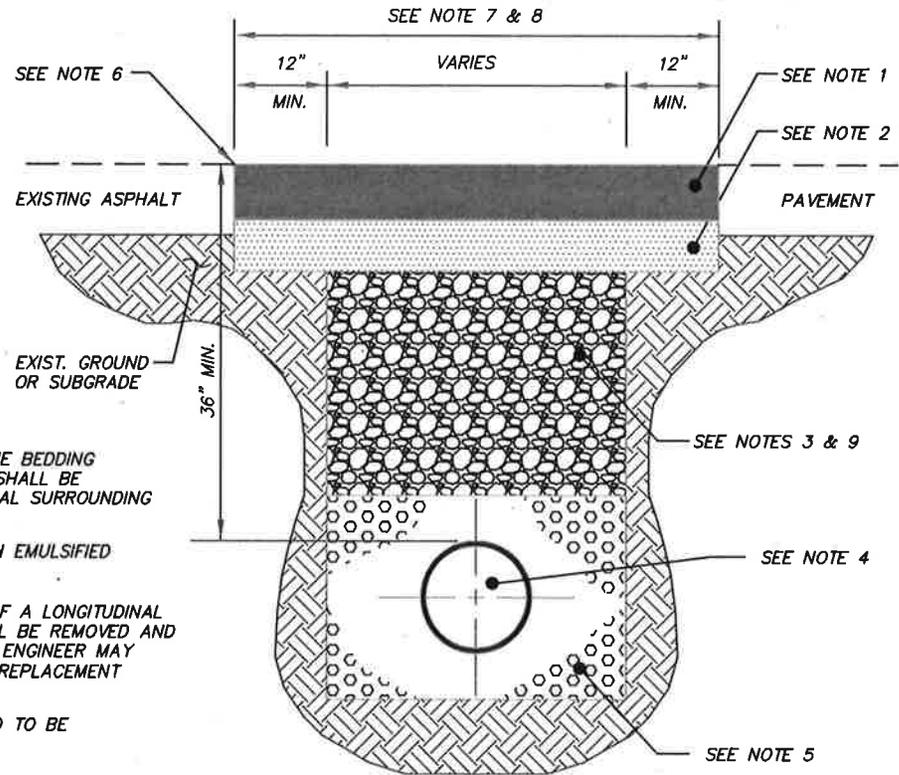

RESTORATION DETAIL FOR UTILITY ROAD CUTS

NOT TO SCALE

P:\KEM\STANDARD DWG\SECTION 4\PAVEMENT PATCH DM.A7.1.DWG



CITY OF DES MOINES
PUBLIC WORKS DEPARTMENT

TRANSPORTATION SERVICES
21650 11TH AVENUE SOUTH
DES MOINES, IA 50319



SAILS WITH PRIDE

REVISION	APP	DWN
XXXXXXXXXX	XXX	XXX

PAVEMENT PATCHING
AND RESTORATION DETAILS
GENERAL REQUIREMENTS

DM.A7.1